


NOTE: 1/4" per foot Maximum Transverse Slope

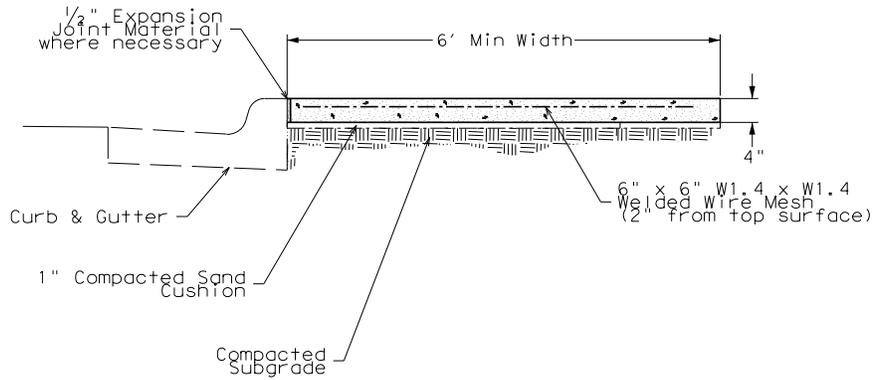

NOTES:

1. All flatwork shall use Class A (minimum 3,000 psi at 28 days) concrete unless otherwise detailed or specified. Concrete requirements for flatwork of any other class shall be labeled on the plans and called out in the specifications.
2. No reinforcement wire will be closer than three inches (3") to edge of concrete.
3. 1/2" preformed expansion joint material shall be placed at intervals not to exceed thirty feet (30') in the sidewalk or as directed by the engineer. Scoring joints (dummy joints) shall be placed in sidewalks with jointing tools at intervals not to exceed five feet (5').
4. 1" sand cushion shall be wetted and forms oiled prior to placing any concrete.
5. When sidewalk is located at Back of Alley Apron or Back of Driveway, increase thickness to six (6") inches minimum.

<p>CITY OF AMARILLO</p> <p>ENGINEERING DEPARTMENT</p>	<p>DRAWN BY:</p> <p>rjh</p>	<p>DATE:</p> <p>8/18/2010</p>	<p>DESCRIPTION</p> <p>Commercial Sidewalk</p>
	<p>DESIGNED BY:</p> <p>rjh</p>	<p>JOB NO:</p>	
	<p>PATH:</p>		
	<p>SCALE:</p> <p>1" = 10'</p>	<p>SHEET</p> <p>1</p>	